

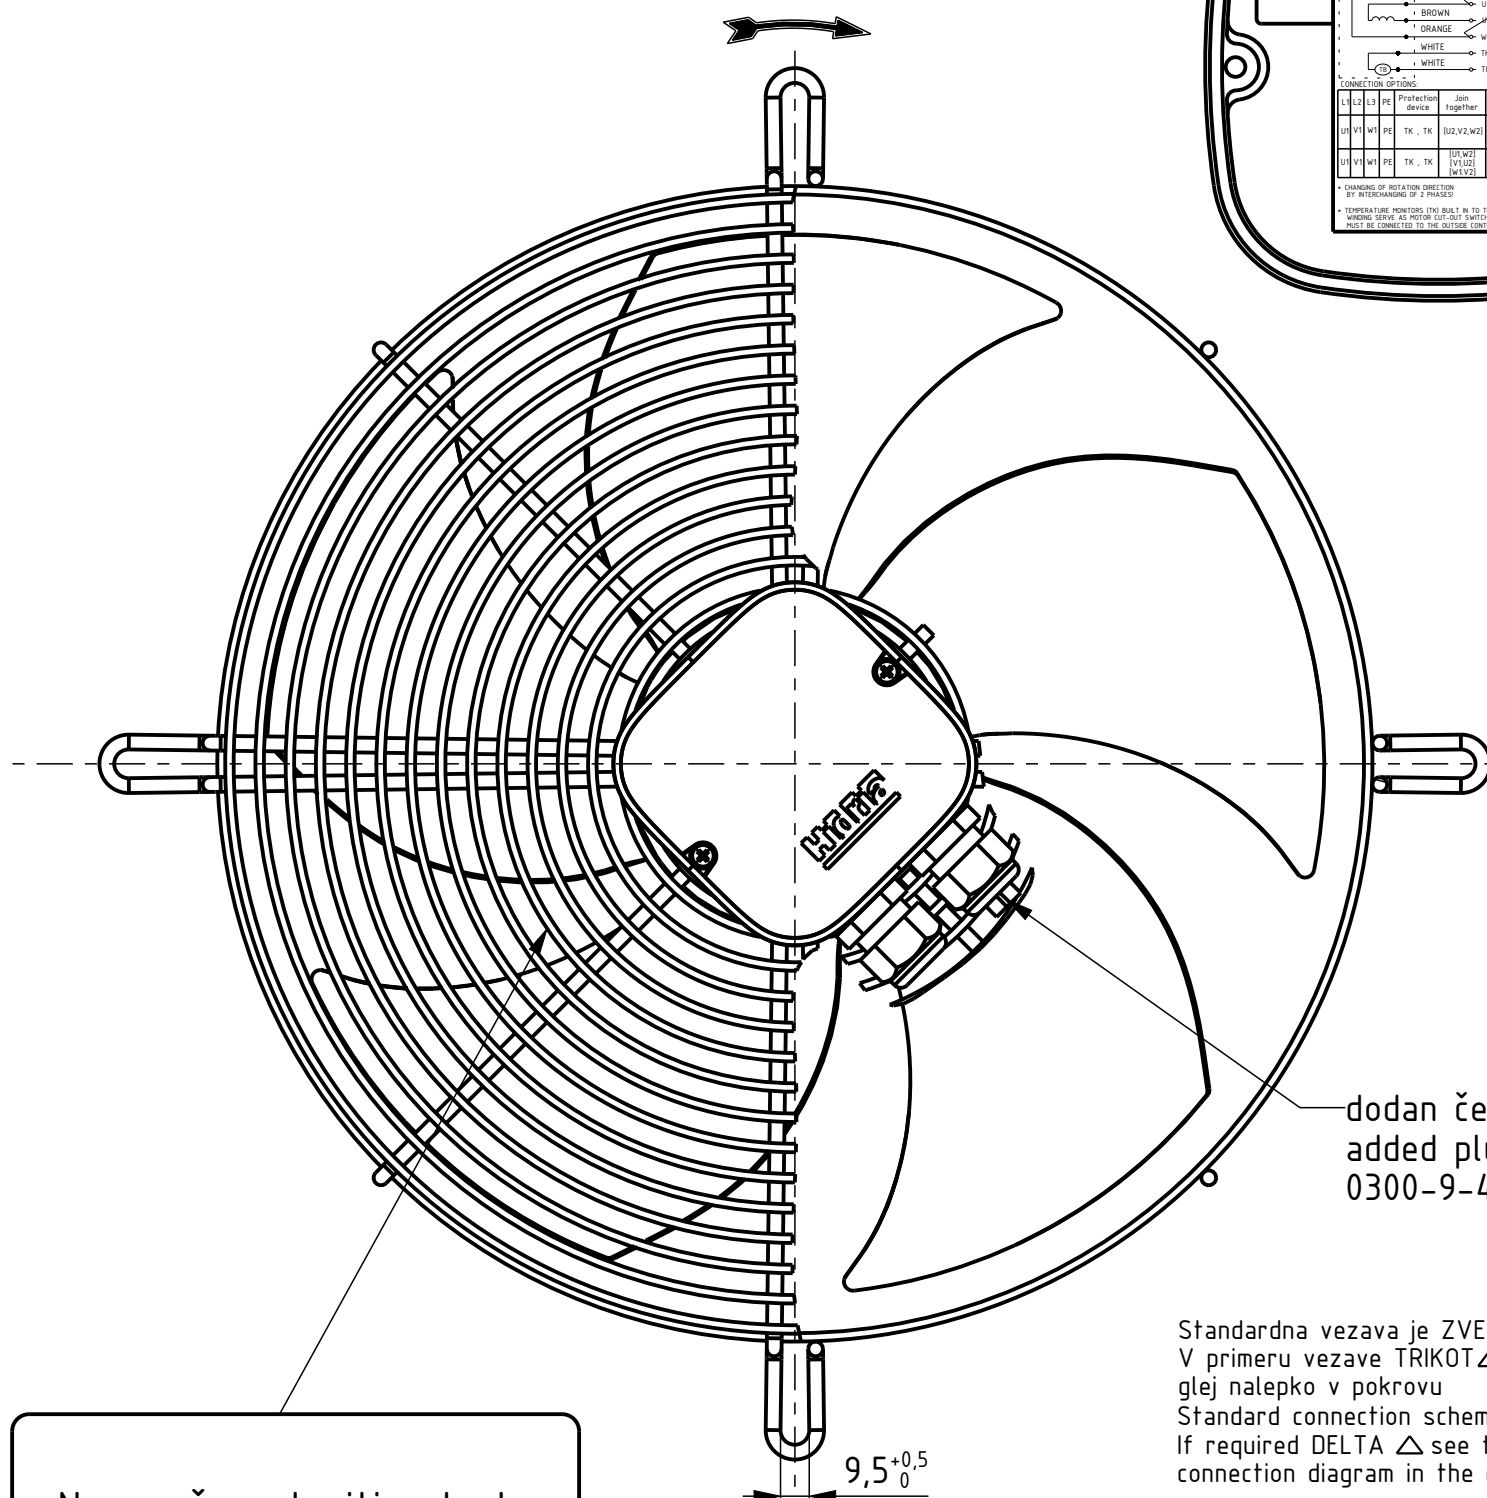
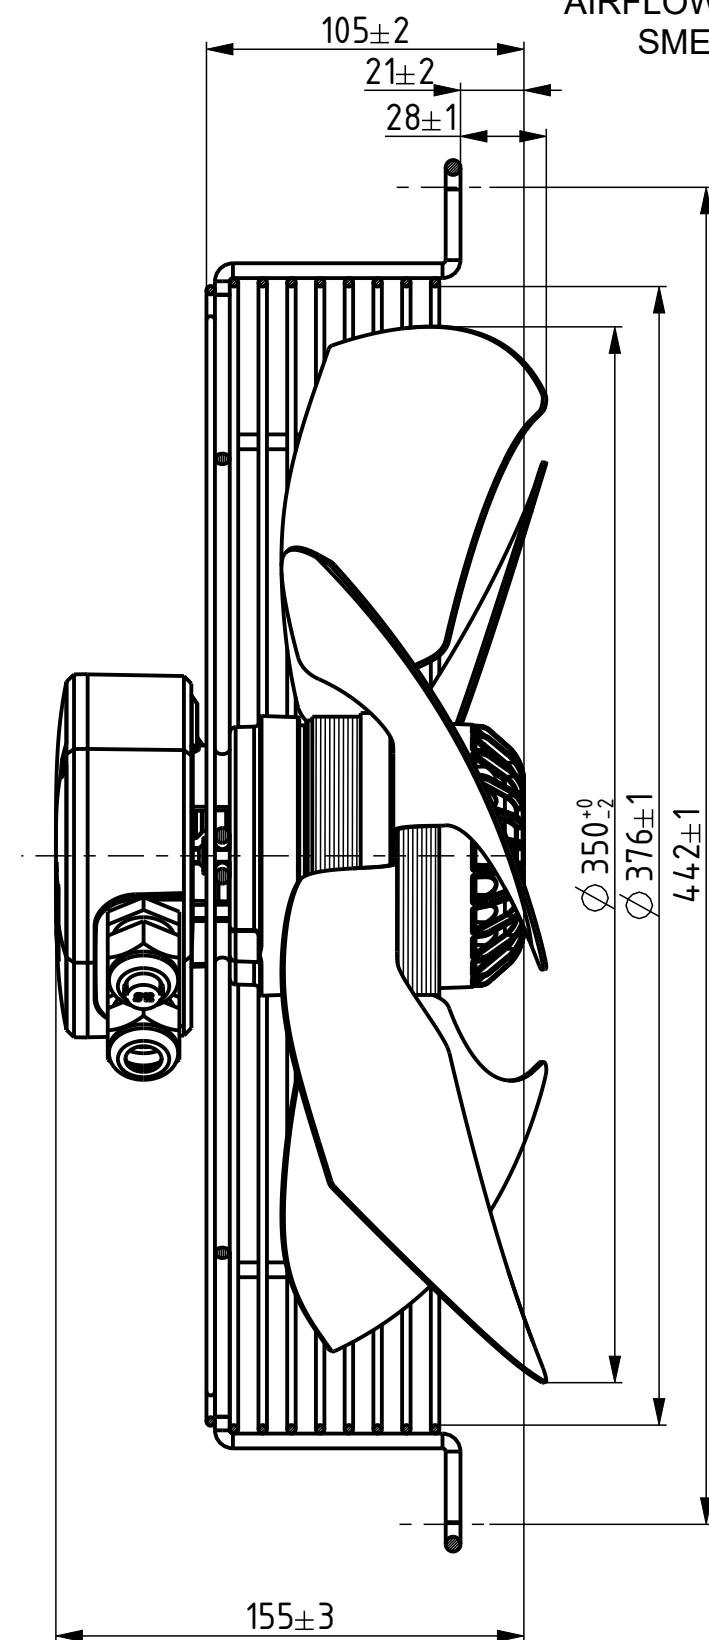
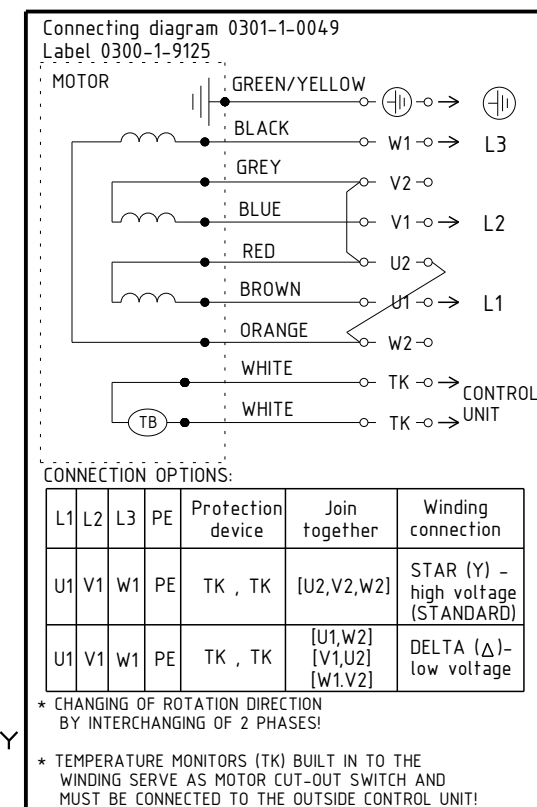


SUCKING
AIRFLOW DIRECTION
SMER ZRAKA

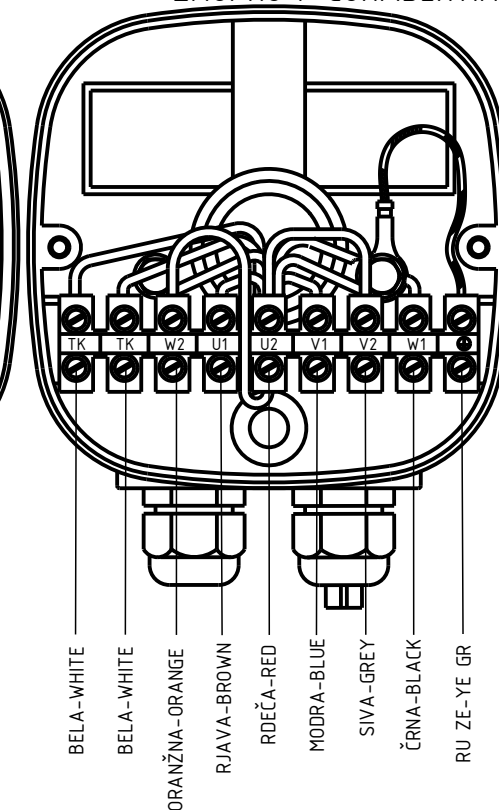


—dodan čep
added plug
0300-9-4309

Standardna vezava je ZVEZDA Y
V primeru vezave TRIKOT Δ
glej nalepko v pokrovu
Standard connection scheme is STARY
If required DELTA Δ see the
connection diagram in the cover

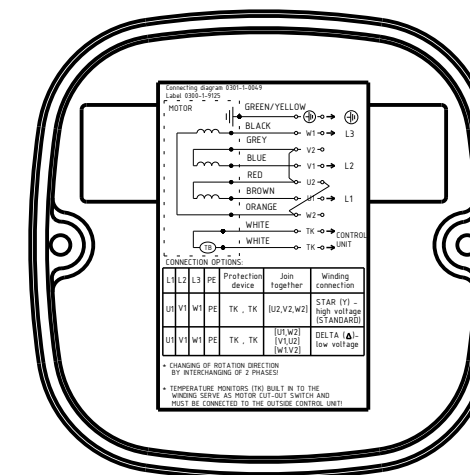

Na mrežo nalepiti nalepko
0300-1-9373

AE	AE	Sprememba na nalepki. Dodan znak UKCA. The label data changed. Risba v Windchillu, je skladna z risbo v arhivu.		04.03.2022	Matjaž H.
AD	AD	V uvodnico se dodaja čep 0300-9-4309. Spremeni se verzija artikla z AC v AD. Risba v Windchillu je skladna z risbo v arhivu.		08.09.2016	Uroš K.
Verzija Artikla: Article revision:	Verzija risbe: DRW Revision:	Opis spremembe: Description of change:		Datum: Date:	Izdelal: Produced:
	DATUM/DATE	IME / NAME		NAZIV: TITLE: VENTILATOR R09R-3530HA-4T-4250	
KONSTRUIRAL / DRN:	04.03.2022	Matjaž Habe			
ODOBRIL / APP:	15.03.2022	Jure Laharnar			
Potrjeno/Approved					
		KODA MATERIALA MATERIAL CODE		MASA: MASS:	
		NETOL. MERE/UNTOL DIM		DZJ	
		MERILO/FORMAT 2:5/A3			
				KODA: CODE:	0309-4-1087 0309-4-1087
		VERZIJA ARTIKLA: REVISION ARTICLE:		VERZIJA RISBE: DRW REVISION	
		AE		AE	
		LIST/SHEET:		1/1	

Navodila za kontrolo ventilatorja 0301-1-4755
Fan checking instruction 0301-1-4755


 MADE IN SLOVENIA
 

 US (E250222)
 
 DATE

R09R-3530HA-4T-4250
 0309-4-1087

3~Y400V/D230V 50Hz 152W 0,34/0,59A 1305RPM MAX.AMB.65°C

3~Y400V/D230V 60Hz 190W 0,34/0,60A 1375RPM MAX.AMB.65°C

3~Y460V/D265V 60Hz 220W 0,36/0,63A 1500RPM MAX.AMB.65°C

IP54 INS.CL.F AO TH.PROT. ROT. 

ErP: Effes=29,5% (A.static) N=41,2